


Gas Total kWh with Heating Degree Days

■ Total Energy kWh

— Total HDD

Base Temperature: 15.5°C

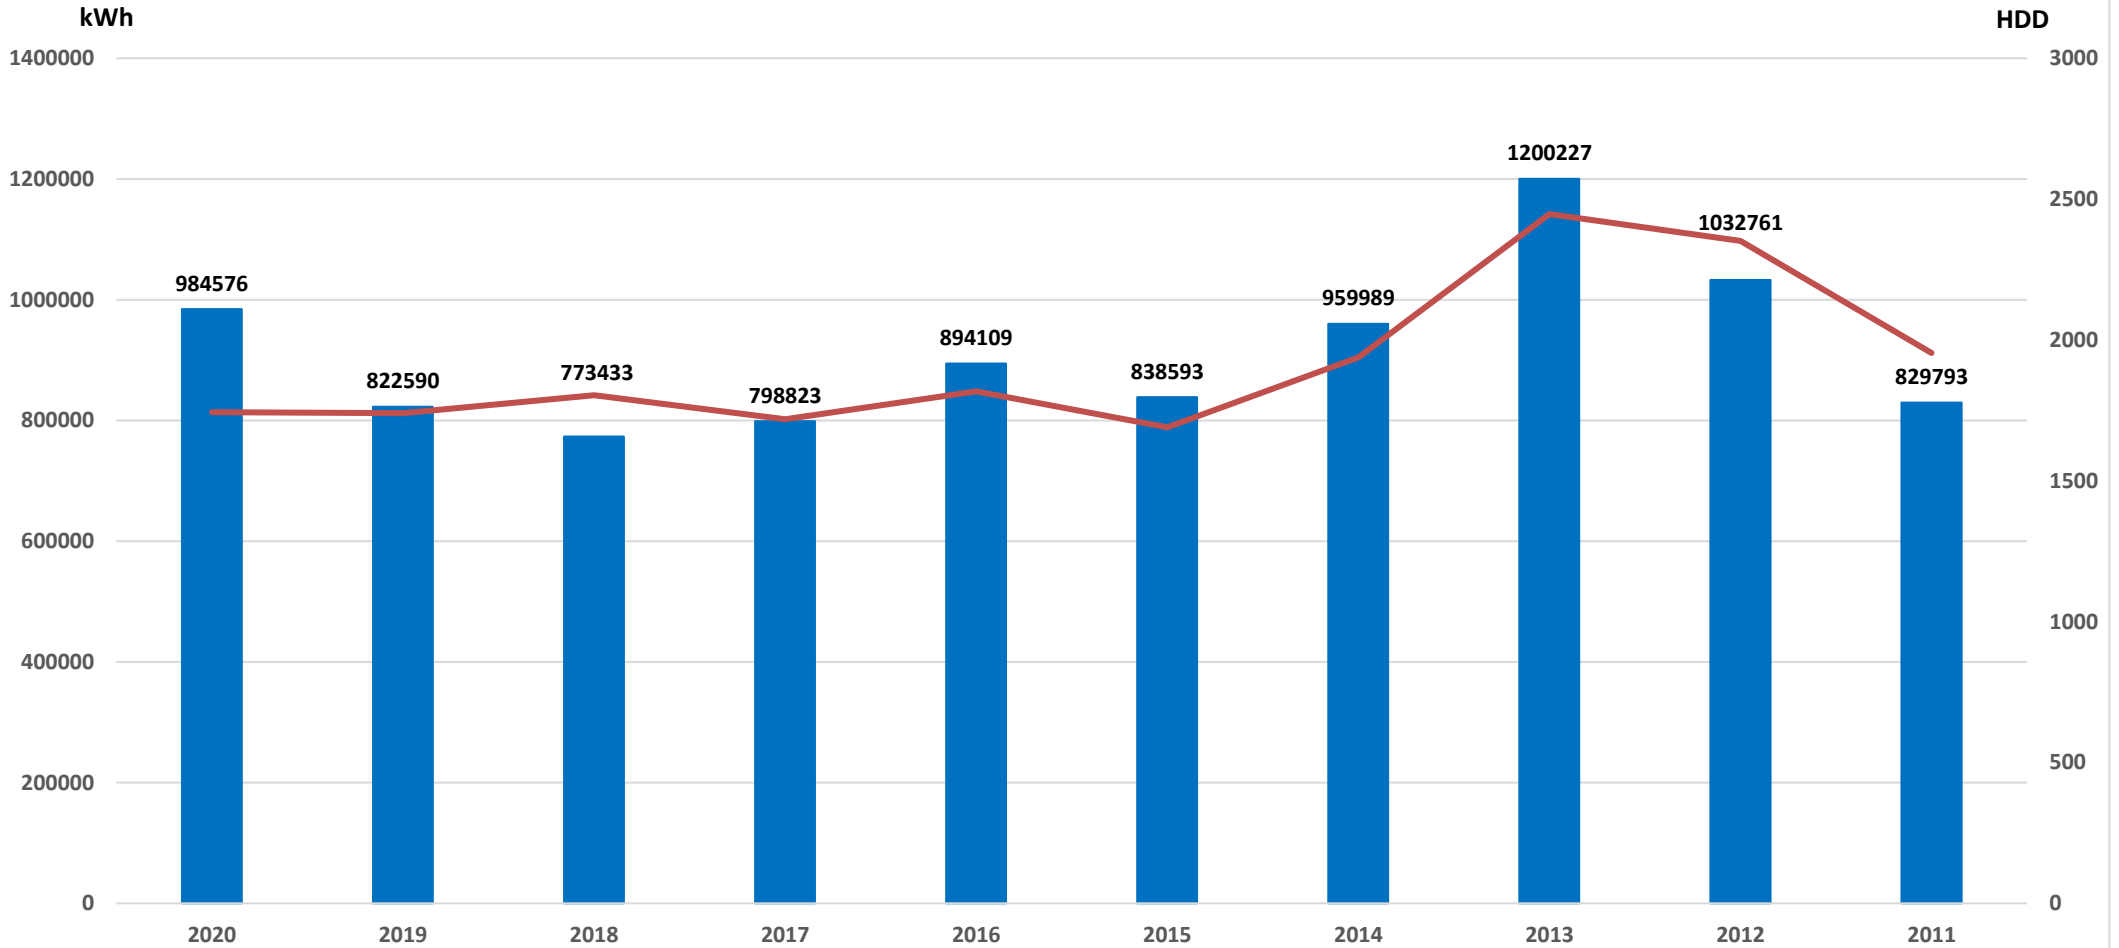

School Closed for 4 Months due to Coronavirus Lockdown Sep to Dec Ventilation a Priority

New Block and Harding Hall Roofs Replaced + Harding Hall Boiler House Refurbished

Main Block Boiler House Refurbished

Main Block and Gym Flat Roofs
(Music and Tower Not Included)

Windows Replaced in Science, Dining Room, Main Hall, Offices, Staffroom

New Blk Boiler Hse Refurbished

6FSC Built and New Blk Partially Refurbished